


CIRCUIT INSTALATIE  
INCALZIRE RADIATOARE

COMANDA POMPA CIRCULATIE BOILER 230V

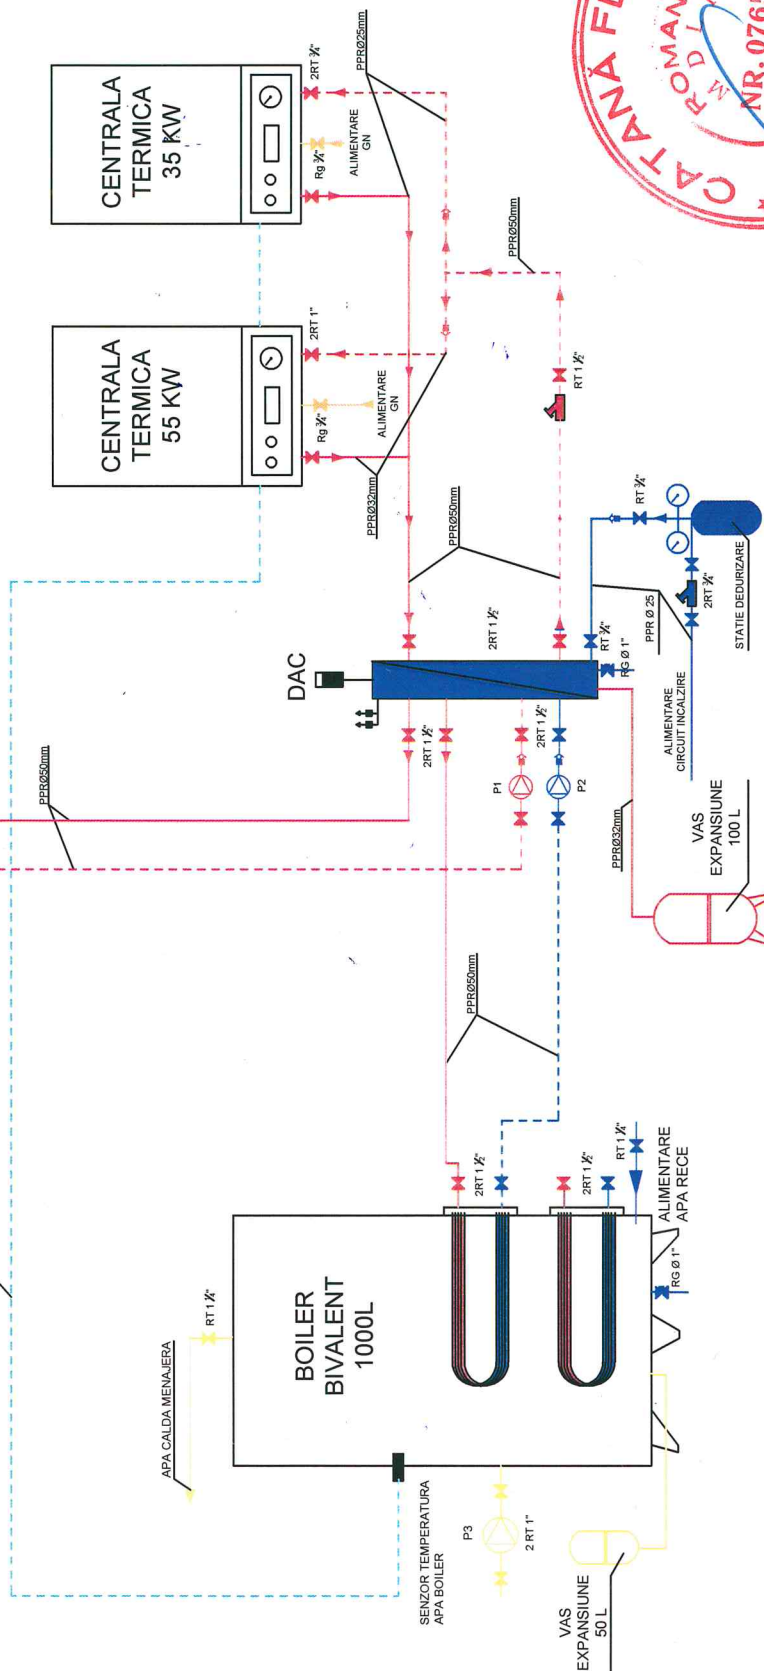

# LEGENDA

- P1 POMPA CIRCULATIE CIRCUIT INCALZIRE
- P2 POMPA CIRCULATIE CIRCUIT BOILER ACM
- P3 POMPA RECIRCULARE CIRCUIT ACM
- SUPAPA SIGURANTA DN 25
- FILTRU Y Ø 1 1/2"
- SUPAPA SENS
- BUTELIE DE EGALIZARE
- TUR CIRCUIT INCALZIRE
- RETUR CIRCUIT INCALZIRE
- ROBINET ALIMENTARE GN
- ROBINET TRECCERE CU BILA
- DISPOZITIV AERISIRE AUTOMAT DN 15mm INCLUSIV VANA SEPARATE
- ROBINET GOIURE



VERIFICATOR/EXPERT	NUME	SEMNATURA	CERINTA	REFERINTE/EXPERTIZA	NUMAR/DATE
SC AUM SRL BUZAU J10/2522/1992	Beneficiar: EA CAMPUS CORPORATION SRL BUZAU				38 2018
Sef proiect: arh. Mares Aurelian Proiectat: ing. Colocaru Eduard Verificat: arh. Mares Aurelian	Proiect: CAMIN STUDENTESC P+3E str. HANGARULUI, nr. 6, Buzau				T 4
				SCHEMA TERMOMECHANICA	